

Connecticut Water Company
93 West Main Street
Clinton, CT 06413-1600

Office: 860.669.8636
Fax: 860.669.9326
Customer Service: 800.286.5700



September 17, 2007

Chairman
Zoning Board of Appeals
Town Hall
1540 Sullivan Avenue
South Windsor, CT 06074

Dear Sir or Madam:

Connecticut Water Company has a source of groundwater public drinking water supply and aquifer area located within your town. Section 8-3i of the CT General Statutes requires an applicant who proposes any activity within an aquifer area to provide written notice of their application to the affected water company if such water company has filed a map showing the boundaries of the Level A or B aquifer protection area as approved by the Department of Environmental Protection. The notification must be made by certified mail, return receipt requested no later than seven days after the date of the application. A copy of this map has previously been provided to your Commission. I would appreciate your cooperation in advising applicants with proposed project within the aquifer area of this notification requirement. I would also appreciate it if you would require the applicant to send us a copy of the site plans and complete the notification form (enclosed) for our review and comments for any proposed projects located within our aquifer area.

Please be advised pursuant to Public Act 06-53, an applicant must also provide notification to the State Department of Public Health (DPH) for projects located with aquifer or watershed areas. The DPH on-line notification form can be found at www.dph.state.ct.us/BRS/Water/Source_Protection/web_form.htm.

As part of our on-going source protection program, I review town Commission agendas for proposed projects, zone changes or other issues within our aquifer areas that have the potential to impact our sources of supply. Receiving adequate notification of proposals located within these environmentally sensitive areas provides us with the opportunity to review plans and submit comments to your Commission to protect our important sources of supply. I would appreciate receiving your agendas so I can determine if I am receiving the required notification. I would prefer to receive the agendas by e-mail at cgaudino@ctwater.com, however, if you prefer to mail the agendas please let me know and I will supply you with postage paid envelopes. If you are already providing me with copies of your agendas, I thank you for your continued cooperation in this important matter.


If you should have any questions, please call.

Sincerely,


A handwritten signature in black ink, appearing to read "Cindy N. Gaudino".

Cindy N. Gaudino
Manager Source Protection and
Real Estate

KUPCHUNOS WELL SITE

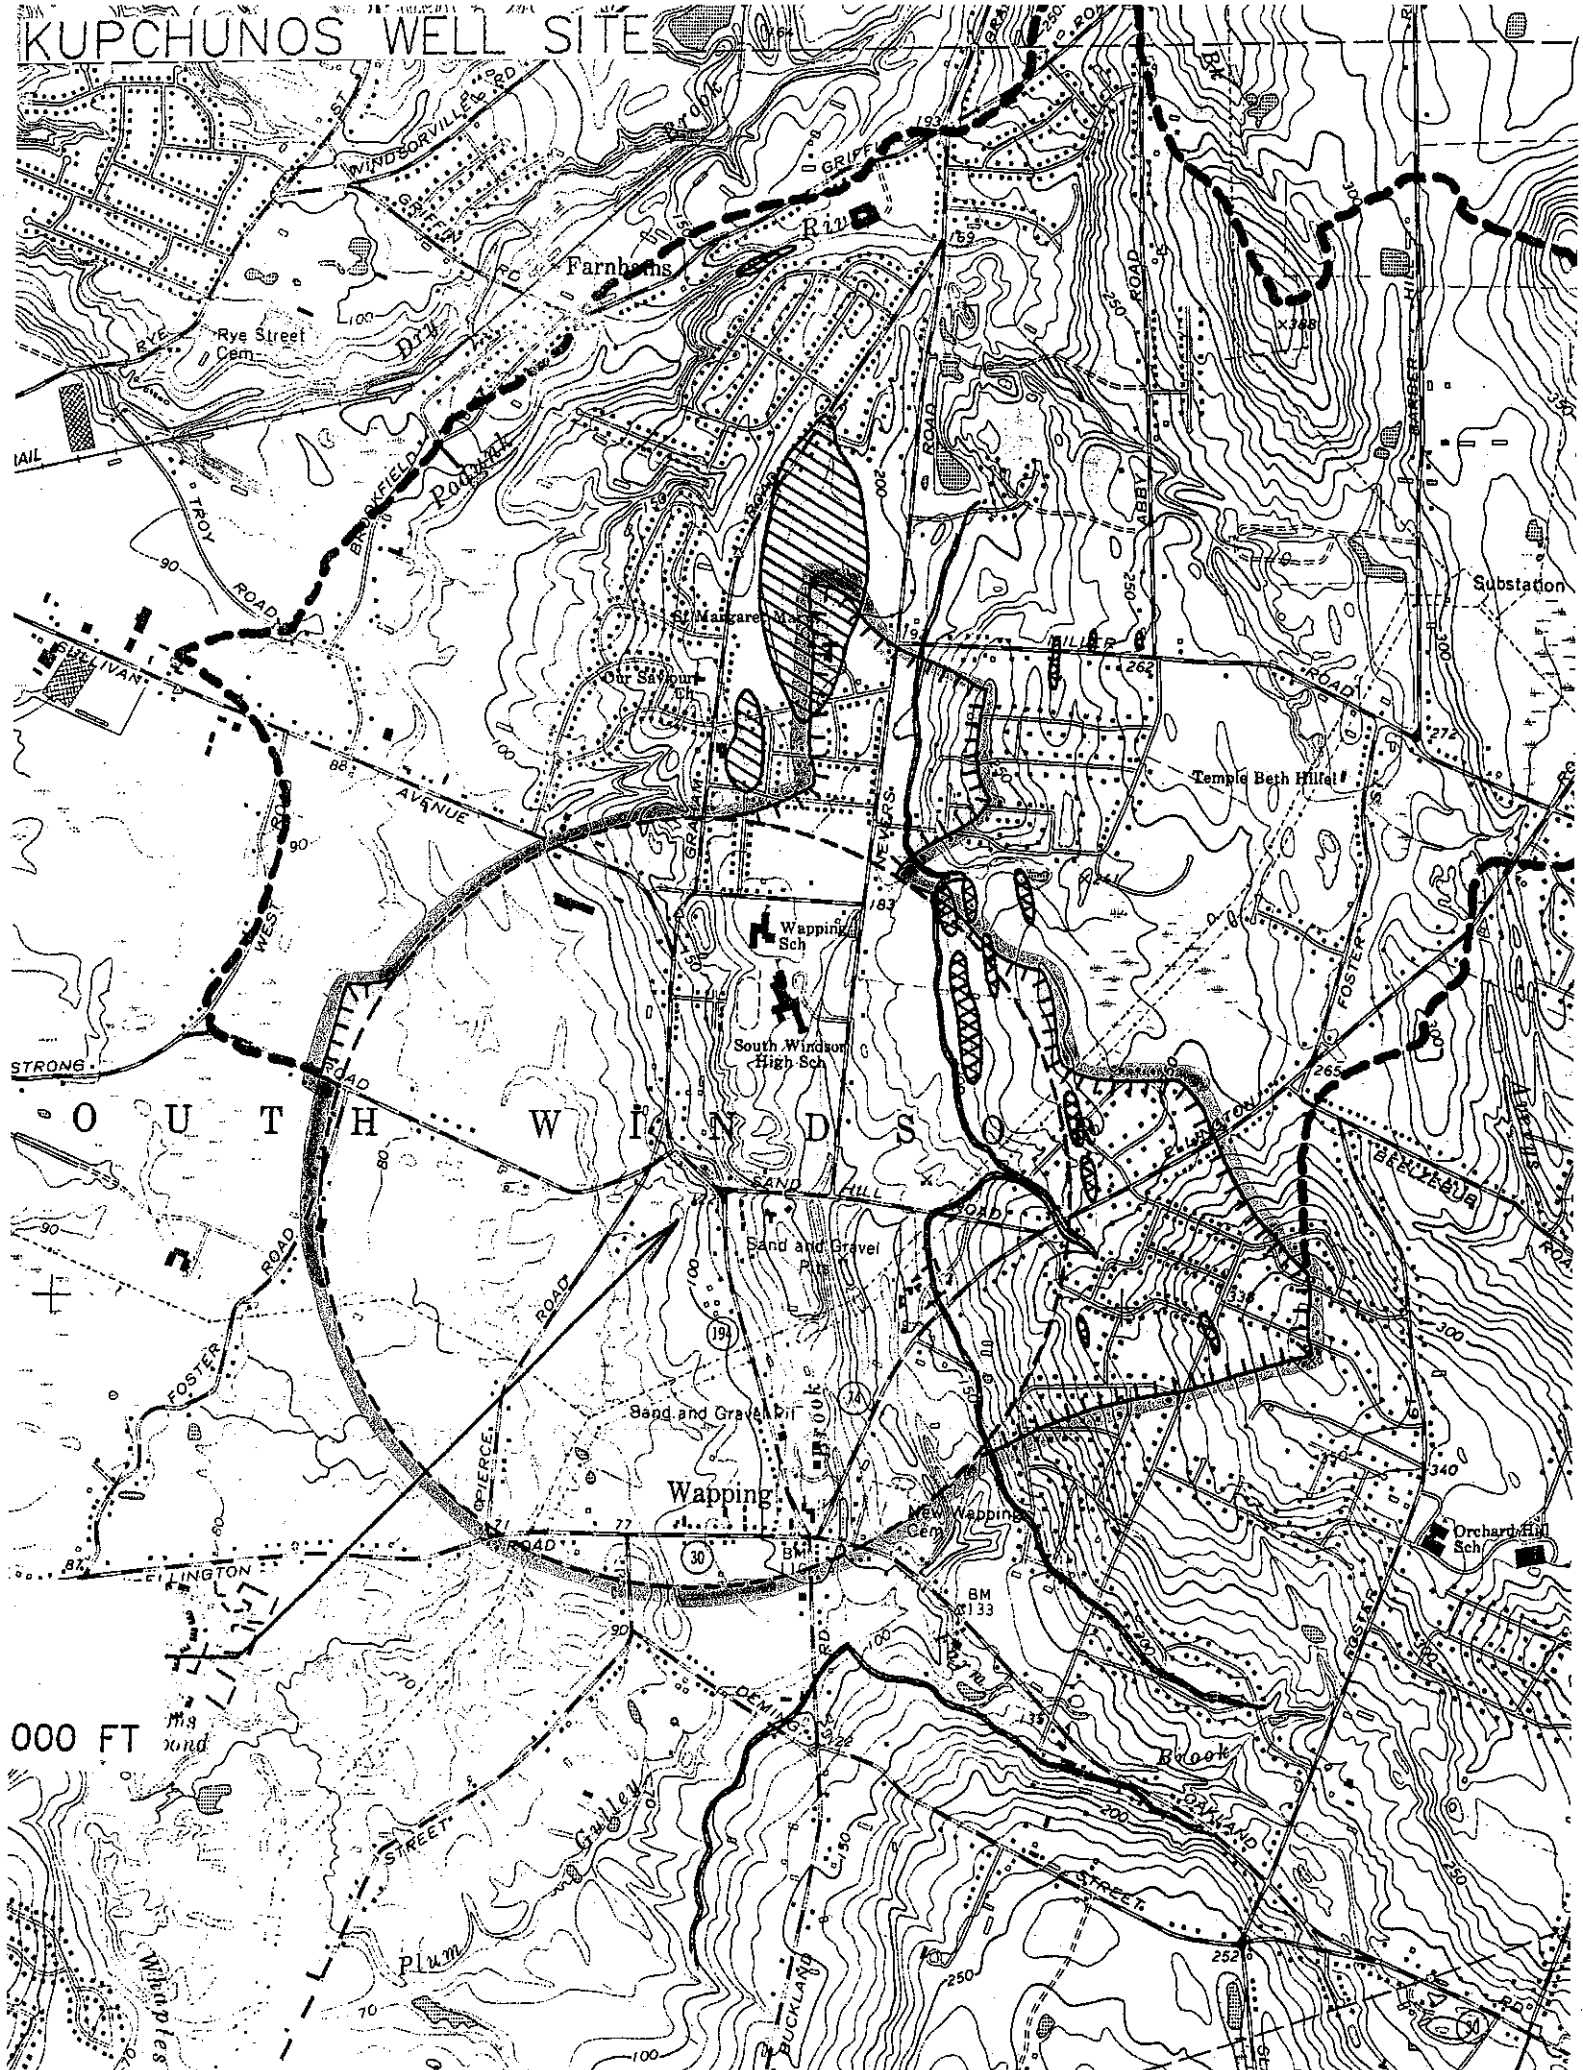

TALCOTTVILLE WELL FIELD

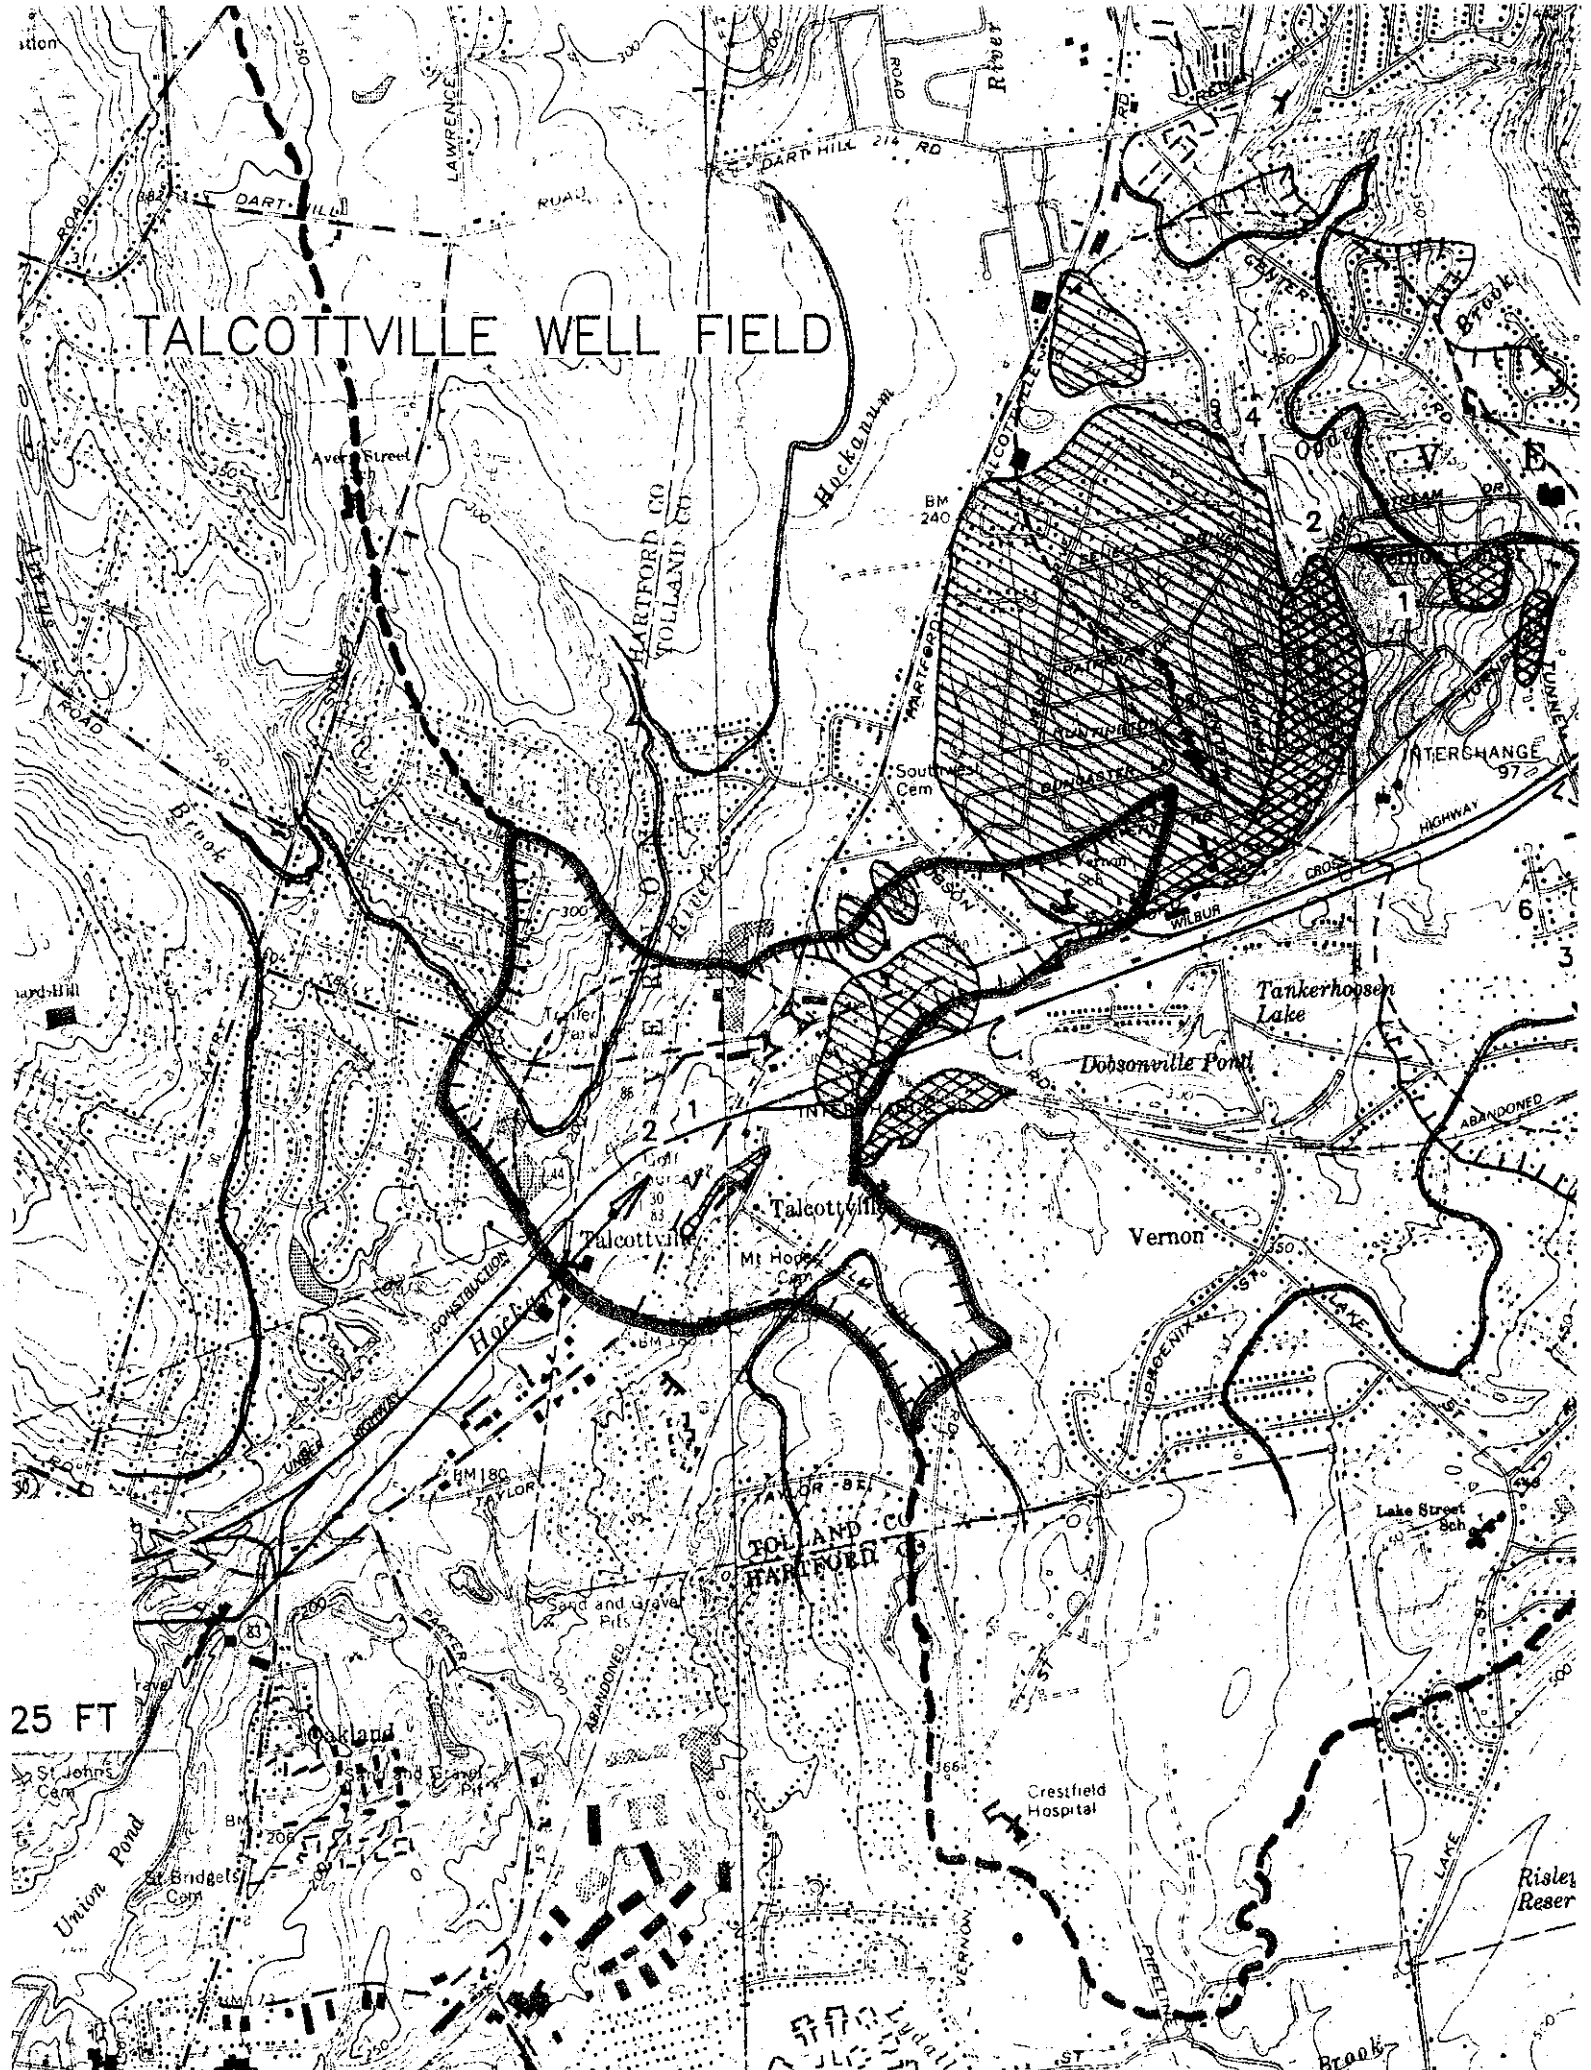

25 FT

Risley Reser

Public Water Supply Aquifer Area Project Notification Form

Requirement:

All applicants before a municipal Zoning Commission, Planning and Zoning Commission or Zoning Board of Appeals for any project located within a public water supply aquifer area are required by Section 8-3i of the CT General Statutes to notify Connecticut Water Company of the proposed project by certified mail not later than 7 days after the date of the application. The notice should be sent to: Cindy Gaudino, Manager Source Protection and Real Estate, Connecticut Water Company, 93 West Main Street, Clinton, CT 06413. The State Department of Public Health must also be notified via on-line registration at:
http://www.dir.ct.gov/dph/Water/Web_form.htm

General Information:

1. Location map of the project site (please show enough information to locate site).
2. Site plans, including soil erosion and sediment control plan, which have been submitted to the town commission for review.
3. Project address _____
4. Total acreage of project site _____
5. Existing land use _____
6. Description of proposed project _____

7. Acreage of area to be disturbed including structures, additions, paving, and soil disturbance _____

8. Type of sanitary system (circle one)- septic system/public sewer/none
9. Number of **existing or proposed** floor drain and their point of discharge e.g. sanitary sewer, holding tank, or ground _____

10. Water accessed by (circle one)- private well/public water/other/none;
If other, please specify _____

11. Distance of site disturbance to nearest watercourse or wetland _____

12. Brief description of **existing and proposed** stormwater management system, including roof drainage, paved areas etc., and discharge points e.g. municipal sewers, drywells, streams, vegetated areas, detention basins etc. _____

13. Type of heat for facility _____

14. List of **existing and proposed** underground or above-ground storage tanks including age, capacity and contents _____

15. List of potentially harmful chemicals stored or used on property (**existing and proposed**) and typical onsite volumes, including but not limited to petroleum products, lubricants, solvents, detergents and pesticides _____

16. Describe any wastes generated and their means of disposal _____

17. Date application will be heard by Planning and Zoning Commission _____

18. Date application will be heard by Zoning Board of Appeals _____

19. Date application will be heard by Inland Wetlands Commission _____

20. Name, address and telephone number of contact person for the project:

Name of person completing form

Signature

Date